

Three-Ply Heat-Welded Modified Bitumen Smooth-Surfaced Roofing System. For use over plywood or other nailable decks on inclines up to 6" per ft (500 mm/m).

Materials per 100 ft² (9.29 m²) of roof area

Sheathing Paper:

Wood board decks only 1 layer

Base Ply:

TRICOR S*, BICOR S*, APPeX 4S, JM APP Base, Ventsulation Felt or PermaPly 28 1 layer

Intermediate Plies:

TRICOR S*, BICOR S*, APPeX 4S or JM APP Base 1 layer

Cap: ♦

3CNS-W—TRICOR S* or BICOR S* 1 layer
3PNS-W—APPeX 4S 1 layer

Surfacing: Coverage*/ 100 ft² (9.29 m²)

Asphalt Emulsion (Formerly TopGard Type B)	3 - 4 gal (11 - 15 l)
TopGard Type A (Aluminum Emulsion)	1½ - 2 gal (6 - 8 l)
Fibrated Aluminum Roof Coating	1½ - 2 gal (6 - 8 l)
TopGard 4000	1 - 2 gal (4 - 8 l)
TopGard 5000	1 - 2 gal (4 - 8 l)
TopGard Base Coat	1 - 2 gal (4 - 8 l)

Approximate installed weight: 185 - 270 lb (84 - 122 kg).

* Coverage rates depend on weather conditions and substrate. Refer to specific code agency Web sites for exact constructions that may require a specific application rate for compliance.

General

This specification is for use over any type of approved structural deck (without insulation) which can receive and adequately retain nails or other mechanical fasteners that are recommended by the deck manufacturer. Examples of these decks are wood, plywood and approved oriented strand board (OSB). This specification is not for use over lightweight insulating concrete decks.

Design and installation of the deck and/or roof substrate must result in the roof draining freely, to outlets numerous enough and so located as to remove water promptly and completely. Areas where water ponds for more than 24 hours are unacceptable and will not be eligible for a JM Peak Advantage Guarantee.


Flashings

Flashing details can be found in Section 3 of the JM Commercial/Industrial Roofing Systems Manual.

Application

Using one of the base plies listed, start with a piece 26¼" (667 mm) wide. The remaining plies are to be applied full width 3" (76 mm) side and 4" (102 mm) end laps over the preceding sheets. Nail the laps at 9" (229 mm) centers, and down the longitudinal center of each felt ply, place two rows of fasteners, with the rows spaced approximately 11" (279 mm) apart, and fasteners staggered on approximately 18" (457 mm) centers. Use nails or fasteners appropriate to the type of deck, with 1" (25 mm) minimum diameter caps. For additional fastener information, refer to the "Roof Decks" section of the current JM Commercial/ Industrial Roofing Systems Manual.

Over the fastened base ply, heat weld a 19¾" (502 mm) piece of one of the intermediate plies listed with 4" (102 mm) side and 6" (152 mm) end laps. The remaining plies are to be applied full width, in the same manner with 4" (102 mm) side and 6" (152 mm) end laps over the preceding sheet.

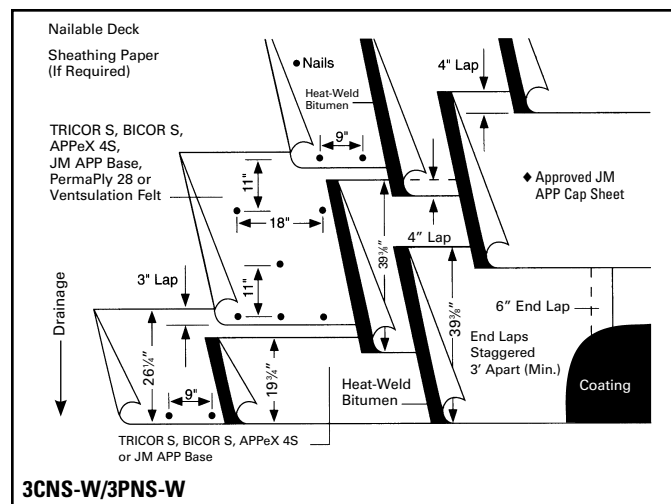

Heat weld a full width piece of one of the cap sheets listed so that it is firmly and uniformly set. Subsequent sheets are to be applied in the same manner, with 4" (102 mm) side and 6" (152 mm) end laps over the preceding sheets. All laps must be rolled with a 3" (76 mm) rounded edge roller. A ⅛" to ⅜" (3 mm to 10 mm) bleedout of APP compound shall be visible at the edge of all seams. All laps must be checked for good adhesion.

Application of JM APP modified bitumen products may require the use of an open flame propane torch. Improper use of these materials and application equipment can result in severe burns, and/or other physical injury, as well as damage to property. In order to prevent these situations the mechanic must install the materials using the techniques recommended by JM and those found in "A Guide to Safety: Torch-On Modified Bitumens" available from the Asphalt Roofing Manufacturers Association. These techniques have been endorsed by the National Roofing Contractors Association and the United Union of Roofers, Waterproofers and Allied Workers.

For cold weather application techniques, refer to Paragraph 14.0 of Section 3k of the JM Commercial/Industrial Roofing Systems Manual.

Steep Slope Requirements

Special procedures are required on inclines over 2½" per ft (208 mm/m).

Surfacing

Finish the entire membrane surface with a uniform application of the selected coating. The coating chosen will depend on aesthetics and any fire rating or code approval required. Refer to paragraph 9.0 of Section 3b or the installation directions printed on the label for more specific information regarding a particular coating.

Note: When using metric- and English-sized sheets in the same system, care must be taken to avoid lap over lap configurations.

Note: For the most current information on general guidelines, please refer to the System Considerations tab under Systems Introduction & Selection on the JM Roofing Web site. For specifications, flashing details and general installation information please refer to the System Application tab.

* This is a special order product. Contact your JM sales representative about availability and lead time.

Refer to the Material Safety Data Sheet and product label prior to using this product.