

Four-Ply White-Coated Mineral-Surfaced Fiber Glass Built-Up Roof. For use over wood or other nailable decks on inclines of up to 6" per ft (500 mm/m).

Materials per 100 ft² (9.29 m²) of roof area

Sheathing Paper:

Wood board decks only 1 layer

Felts:


GlasBase Plus, PermaPly 28 or Ventsulation Felt 1 ply
GlasPly Premier or GlasPly IV 2 plies
GlasKap CR 1 ply

Asphalt (Interply): Trumbull®* or other JM-approved asphalt

Incline per foot	Asphalt	Nominal Weight
Up to 1" (83 mm/m)	170°F (77°C), Type II, Flat	69 lb (31 kg)
1" to 3" (83 to 250 mm/m)	190°F (88°C), Type III, Steep	69 lb (31 kg)
3" to 6" (250 to 500 mm/m)	220°F (104°C), Type IV, Special Steep	69 lb (31 kg)
Up to 6" (500 mm/m)	PermaMop	69 lb (31 kg)

Approximate installed weight: 175 - 260 lb (79.4 - 117.9 kg).

Energy and the Environment

 COOL ROOF RATING COUNCIL		Initial	3-Yr. Aged
	Solar Reflectance	0.76	0.61
Thermal Emittance	0.85	0.92	
Rated Product ID	0662-0007		
Licensed Manufacturer ID	0662		
Classification	Production Line		

Cool Roof Rating Council ratings are determined for a fixed set of conditions, and may not be appropriate for determining seasonal energy performance. The actual effect of solar reflectance and thermal emittance on building construction may vary.

Manufacturer of product stipulates that these ratings were determined in accordance with the applicable Cool Roof Rating normal procedures.

General


This specification is for use over any type of approved structural deck (without insulation) which can receive and adequately retain nails or other types of mechanical fasteners that may be recommended by the deck manufacturer. Examples of such decks are wood and plywood. This specification is not for use directly over lightweight, insulating concrete decks.

Design and installation of the deck and/or substrate must result in the roof draining freely and to outlets numerous enough and so located as to remove water promptly and completely. Areas where water ponds for more than 24 hours are unacceptable and are not eligible to receive a JM Peak Advantage Guarantee.

Note: All general instructions contained in the current JM Commercial/Industrial Roofing Systems Manual should be considered part of this specification.

Flashings

Flashing details can be found in Section 3 of the JM Commercial/Industrial Roofing Systems Manual.

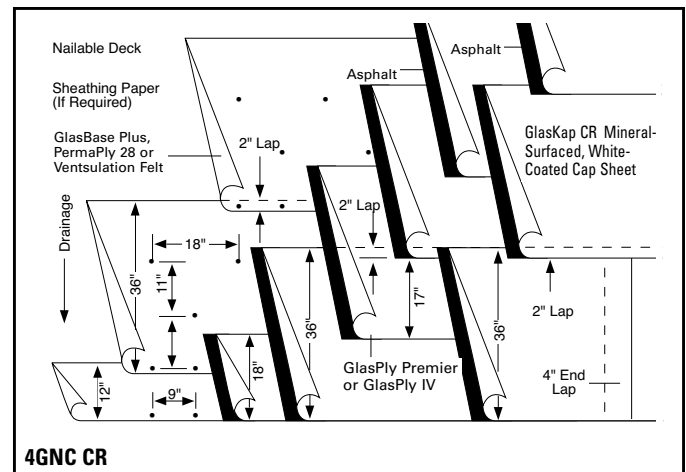

Application

Over wood board decks, one ply of sheathing paper must be used under the base felt and on top of the wood board deck.

Note: On roof decks with slopes up to 1" per ft (83 mm/m), the roofing felts may be installed either perpendicular or parallel to the roof incline. On slopes over 1" per ft (83 mm/m), refer to Paragraph 11.0 of Section 3b for special requirements.

Using GlasBase Plus, PermaPly 28 or Ventsulation Felt, start with a 12" (305 mm) width sheet (a specific base sheet may be a condition of Guarantee). The following base sheet courses are to be applied full width, lapping the preceding felt 2" (51 mm) on the side laps and 4" (102 mm) on the end laps. Nail the side laps 9" (229 mm) o.c. Down the longitudinal center of each felt, place two rows of nails spaced approximately 11" (279 mm) apart, with the nails staggered on approximately 18" (457 mm) centers. Use nails or fasteners appropriate to the type of deck with 1" (25 mm) minimum diameter caps. For additional fastener information, refer to the "Roof Deck" section of the current JM Commercial/Industrial Roofing Systems Manual.

Using GlasPly Premier or GlasPly IV, apply a piece 18" (457 mm) wide, then over that, a full width piece. The following felts are to be applied full width overlapping the preceding felts by 19" (483 mm) so that at least 2 plies of felt cover the base felt/substrate at all locations. Install each felt so that it is firmly and uniformly set, without voids, into the hot asphalt (within ±25°F [±14°C] of the EVT) applied just before the felt at a nominal rate of 23 lb/100 ft² (11 kg/9.29 m²) over the entire surface.

Refer to the Material Safety Data Sheet and product label prior to using this product.



BUR Asphalt-Applied Specifications 4GNC CR (cont'd)

Surfacing

Prior to application of GlasKap CR, cut the cap sheet into handleable lengths (12' - 18' [3.66 m - 5.50 m]). Lay the material out on the roof and allow it to relax and flatten. To accommodate a full width sheet, apply a mopping of hot asphalt, approximately 20°F (11°C) above the EVT, at a nominal rate of 23 lb/100 ft² (11 kg/9.29 m²). (The higher temperature of asphalt maximizes the bonding of the cap sheet to the ply felts.) Then flop the cap sheet into the hot asphalt. On subsequent courses, a slop sheet can be positioned upside down, directly over the sheet in the preceding course such that only the side lap area of the preceding sheet is exposed. Care should be taken to maintain 2" (51 mm) side laps and 4" (102 mm) end laps. Asphalt is applied in the same manner as before, making sure to also cover the 2" (51 mm) exposed side lap. Asphalt may also be applied to the exposed "upside down" cap sheet, prior to "flopping" it into the hot asphalt. The cap sheet must be firmly and uniformly set, without voids, into the hot asphalt with all edges and laps well sealed.

Finishing

It is important to be careful with asphalt when applying the GlasKap CR sheets on the roof. However, if a small amount of asphalt bleeds out at the side or end laps, the roof will still meet California Title 24 requirements. Bleed out of less than 1" (25 mm) is acceptable, but 3/8" (10 mm) is recommended.

Some applicators or building owners may want to dress up the roof by coating the asphalt to give the roof surface a uniform white appearance. This is an optional step. JM recommends using a heavy nap roller, in a 4" (102 mm) width, to coat the exposed asphalt with a JM-recommended white acrylic coating.

Asphalt

Asphalt should meet the requirements of ASTM D 312.

JM guarantees require the use of Trumbull®* asphalt or another JM-approved asphalt.

Check with a JM Technical Services Specialist for special asphalt requirements in hot climates.

Note: For the most current information on general guidelines, please refer to the System Considerations tab under Systems Introduction & Selection on the JM Roofing Web site. For specifications, flashing details and general installation information please refer to the System Application tab.

* Trumbull is a registered trademark of Owens Corning.

Refer to the Material Safety Data Sheet and product label prior to using this product.