

BUR Cold Application Specifications Specification 4GNS-CA

**Four Ply Fiber Glass Cold Application Built-Up Roof
Smooth Surfaced. For use over wood or other nailable
decks on inclines of up to 3" per foot (250 mm/m).**

Materials per 100 sq ft (9.3 m²) of Roof Area

Sheathing Paper (Wood board decks only)	1 layer
--	---------

Felts:

Ventsulation or GlasTite Flexible	1 layer
GlasBase Plus or GlasTite Flexible	3 layers

Interply: JM BUR Adhesive or
MBR Cold Application Adhesive

Incline per foot	Adhesive Type	Per 100 sq ft (9.3 m ²)	l/m ²
Up to 3" (250 mm/m)	JM BUR Adhesive or MBR Cold Application Adhesive	4 1/2-6 gal	1.8-2.4

Surfacing:

JM TopGard Type B	3 gal	1.2 l/m ²
JM Aluminum Roof Coating	1 1/2 gal	0.6 l/m ²
TopGard 4000	1 - 1 1/2 gal (0.4 - 0.6 l/m ²) (over smooth sheets)	
TopGard 4000	1 1/2 - 2 gal (0.6 - 0.8 l/m ²) (over mineral sheets)	
TopGard 5000	1 - 1 1/2 gal (0.4 - 0.6 l/m ²) (over smooth sheets)	
TopGard 5000	1 1/2 - 2 gal (0.6 - 0.8 l/m ²) (over mineral sheets)	
TopGard Base Coat	1 - 1 1/2 gal (0.4 - 0.6 l/m ²) (over smooth sheets)	
TopGard Base Coat	1 1/2 - 2 gal (0.6 - 0.8 l/m ²) (over mineral sheets)	

Approximate installed weight: 174-247 lb (79 - 112 kg).

General

This specification is for use over any type of approved structural deck (without insulation) which can receive and adequately retain nails or other types of mechanical fasteners that may be recommended by the deck manufacturer. Examples of such decks are wood and plywood. This specification is not for use directly over lightweight, insulating concrete decks.

Design and installation of the deck and/or substrate must result in the roof draining freely and to outlets numerous enough and so located as to remove water promptly and completely. Areas where water ponds for more than 24 hours are unacceptable and are not eligible to receive a Johns Manville Roofing Systems Guarantee.

Note: All general instructions contained in the current JM Commercial/Industrial Roofing Systems Manual should be considered part of this specification.

Flashings


Flashing details can be found in the "Flashing" section of the JM Commercial/Industrial Roofing Systems Manual.

Application

Over wood board decks, one ply of sheathing paper must be used under the base felt and on top of the wood board decks. Base sheet shall be cut into 18 foot (5.5 m) lengths and be allowed to relax before being installed.

Note: On roof decks with slopes up to 1" per foot (83.3 mm/m), the roofing felts may be installed either perpendicular or parallel to the roof incline. On slopes over 1" per foot (83.3 mm/m), refer to **Paragraph 6.11** of this section for special requirements.

Using JM Ventsulation, GlasBase Plus or GlasTite Flexible, start with an 18" (457 mm) width (the use of a specific base sheet may be a condition of guarantee). The following base sheet courses are to be applied full width, lapping the preceding felt 2" (51 mm) on the side laps and 4" (102 mm) on the end laps.

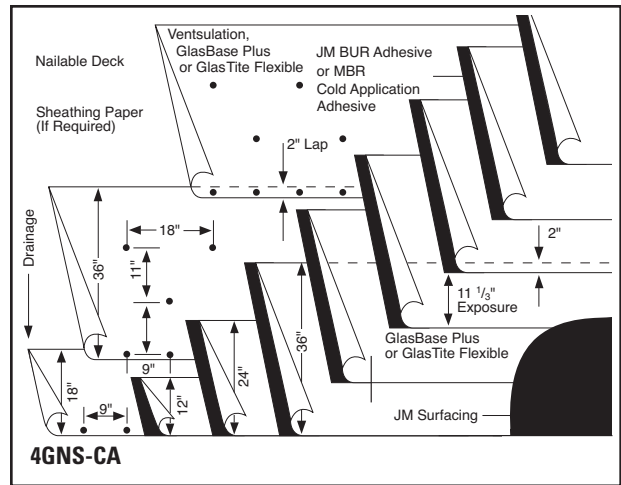

Nail the side laps 9" (229 mm) o.c. Down the longitudinal center of each felt, place two rows of nails spaced approximately 11" (279 mm) apart, with the nails staggered on approximately 18" (457 mm) centers. Use nails or fasteners appropriate to the type of deck with 1" (25 mm) minimum diameter caps. For additional fastener information, refer to the Fastener Data in the "Roof Deck" section of the current JM Commercial/Industrial Roofing Systems Manual.

Using GlasBase Plus or GlasTite Flexible, apply a piece 12" (305 mm) wide, then over that, one 24" (610 mm) wide, then over both, a full width piece. The following felts are to be applied full width, overlapping the preceding felts by 24 3/8" (627 mm) so that at least 3 plies of felt cover the base felt at all locations. Install each felt so that it is firmly and uniformly set, without voids, into the JM BUR Adhesive or MBR Cold Application Adhesive, applied before the felt at a rate of 1 1/2 to 2 gallons per square (0.6-0.8 l/m²) over the entire surface. Roll installed felts with a weighted roller before the end of each work day.

Surfacing

After the interply adhesive has cured, apply two coats of JM TopGard Type B at the rate of 3 gallons per square (1.2 l/m²) per coat. Base flashing, parapet walls, vents, and designated equipment shall also be sprayed with the surfacing.

As soon as the emulsion surfacing has been thoroughly cured (1-3 days), clean up debris, scrubbing out any pockets of residue. Over the clean surface, apply JM Aluminum Roof Coating at the rate 1 1/2 gallons per square (0.6 l/m²) or apply TopGard Base Coat and TopGard 4000 or 5000 at a rate of 1 to 1 1/2 gallons per square (0.4 - 0.6 l/m²). Follow all manufacturers' instructions.

Areas that peel shall be redone at the contractor's expense.

Adjacent walls not scheduled for emulsion and reflective coating shall be masked off with masking tape at upper edge of flashing system prior to any spray application.

Check with a JM Technical Service Specialist for special requirements.

Refer to the Material Safety Data Sheet and Product Label prior to using this product.