

Base Flashing

For non-load-bearing construction, using roof-to-wall expansion joint cover

General

This flashing specification is for use on non load-bearing construction, or where there is any potential for differential movement between the deck and the wall or parapet. The vertical wood curb should be fastened to the deck only.

Note: All general instructions contained in the current JM Commercial/Industrial Roofing Systems Manual shall be considered part of this specification.

Wall Preparation: Any previously installed metal cap or counterflashing must be lifted or removed, to permit application of the expansion joint cover.

Materials

Base Flashing and Expand-O-Flash: Approximately 100 lin ft (30.48 lin m) of base flashing (8" [203 mm] high above the roof) and Expand-O-Flash can be installed with the following materials. Usage will vary depending on actual flashing height and field conditions.


FesCant Plus	100 lin ft (30.48 lin m)
DynaGrip™ Cap	100 ft ² (9.29 m ²)
MBR® Flashing Cement or MBR® Utility Cement	4 - 5 gal (15.1 - 18.9 l)
Expand-O-Flash Style CF-EJ	9 gal (34.1 l)
Bestile Industrial Roof Cement or MBR Flashing Cement or MBR Utility Cement	100 lin ft (30.48 lin m) 3 gal (11.4 l) 2 gal (7.6 l) 4 gal (15.1 l)

Application

Base Flashing: The roofing membrane must extend to the top of the cant. The completed base flashing shall extend not less than 8" (203 mm) above the level of the roof, and shall extend onto the roof membrane a minimum of 4" (102 mm). Cut the DynaGrip Cap into sections that can be easily handled and installed (6' - 8' [1.83 m - 2.44 m] long), and position upside down on the membrane, to allow the product to relax.

Cold Adhesive Application: Starting just above the point on the curb where the base flashing will terminate, coat the cant and out onto the roof membrane with a layer of MBR Flashing Cement approximately $\frac{1}{16}$ " (1.6 mm) thick, or a layer of MBR Utility Cement approximately $\frac{1}{8}$ " (3 mm) thick. Holding the upper corners of the DynaGrip Cap, position its lower horizontal edge on the roof membrane (minimum 4" [102 mm] from base of cant) and lay it into place over the cant strip and up the curb. The sheet should be "worked-in" to ensure that it is firmly and uniformly bonded.

In self-adhering applications, the vertical joints are to be overlapped a minimum of 4" (102 mm) and well sealed. Mechanically fasten the base flashing on 6" (152 mm) centers along its top edge. Fasteners must have a 1" (25 mm) minimum diameter integral cap, or be driven through 1" (25 mm) minimum diameter rigid metal discs. It is recommended that the vertical laps be covered with a $\frac{1}{8}$ " (3 mm) thick layer of MBR Flashing Cement, or a 4" (102 mm) wide strip of fiber glass mesh or ply felt embedded in and trowelled over with a layer of MBR Utility Cement.

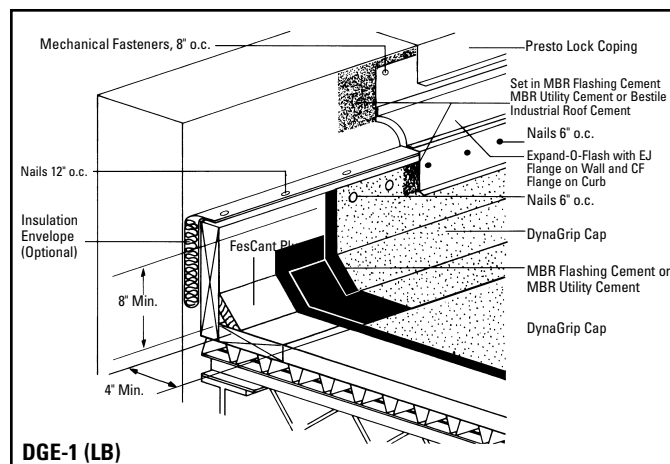

Expand-O-Flash Installation: Install Expand-O-Flash in accordance with the application instructions included with the product. Prefabricated inside and outside corners, as well as horizontal-to-vertical transitions, are available to complete the Expand-O-Flash installation.

Metal Counterflashing: The metal counterflashing of the wall flange should be installed in accordance with the counterflashing manufacturer's specifications and details, or in accordance with SMACNA procedures. Refer to Section 2h on Specialty Roofing Products in the JM Commercial/Industrial Roofing Systems Manual.

Surfacing: DynaGrip Cap requires no additional surfacing.

Note: For the most current information on general guidelines, please refer to the System Considerations tab under Systems Introduction & Selection on the JM Roofing Web site. For specifications, flashing details and general installation information please refer to the System Application tab.

Refer to the Material Safety Data Sheet and product label prior to using this product.